Thyrocare

Tests you can trust

Name : xxxxxxxxxxxxxxxx

Date : xxxxxxxxxxxxxxxx

Test Asked : Vazvg

Report Status: Complete Report

Dummy Report



First National Diagnostic Chain to have **100% of its Labs with NABL Accreditation#**

98% Reports released within **06 Hours** of sample reaching the lab+

9 out of 10 Doctors Trust that Thyrocare reports are Accurate & Reliable*

1200+ Tests & Profiles

Temperature-Controlled Sample Logistics

Unique Barcode Tracking

Fully Automated Machines Inspected Daily

Abnormal Values Re-Checked Twice

Reports Verified By Expert MD Pathologists Stationed at Every Lab

Your reports are digitally verifiable

Scan the QR code inside the report to check authenticity of reported values

QR code will remain active for 30 days from report release date

Accredited by

NABL From 2005#

ISO 9001: 2015 - From 2015

CAP From 2007~

Processed At :

Thyrocare
Tests you can trust

Thyrocare Technologies Limited, D-37/3, TTC MIDC, Turbhe, Navi Mumbai - 400 703. 9870666333 wellness@thyrocare.com

First National Diagnostic Chain to have 100% of its Labs with NABL Accreditation#

Patient Name : XXXXXXXXXXXXXXXX
Referred By : XXXXXXXXXXXXXXXX
Home Collection : XXXXXXXXXXXXXXXX

Tests Done : **VAZVG**
XXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXX

Report Availability Summary

Note: Please refer to the table below for status of your tests.

Ready | **0** Ready with Cancellation | **0** Processing | **0** Cancelled in Lab

TEST DETAILS	REPORT STATUS
VARICELLA ZOSTER VIRUS ANTIBODY - IGG	Ready

Dummy Report

Processed At :

Thyrocare
Tests you can trust

Thyrocare Technologies Limited, D-37/3, TTC MIDC, Turbhe, Navi Mumbai - 400 703. 9870666333 wellness@thyrocare.com

First National Diagnostic Chain to have 100% of its Labs with NABL Accreditation#

Patient Name : XXXXXXXXXXXXXXXX
Referred By : XXXXXXXXXXXXXXXX
Home Collection : XXXXXXXXXXXXXXXX

Sample Collected on (SCT) : XXXXXXXXXXXXXXXX
Sample Received on (SRT) : XXXXXXXXXXXXXXXX
Report Released on (RRT) : XXXXXXXXXXXXXXXX
Sample Type | Barcode : **SERUM | EH420952**

TEST NAME	TECHNOLOGY	VALUE	UNITS
VARICELLA ZOSTER VIRUS ANTIBODY - IGG	E.L.I.S.A	7.6	NTU

Bio. Ref. Interval. :-

Negative : <9 NTU (IgG antibodies absent against Pathogen)
Equivocal : 9-11 NTU (Inconclusive/ Indeterminate results)
Positive : >11 NTU (IgG antibodies present against Pathogen)

Clinical Significance:

- The Varicella Zoster Virus causes Varicella (Chickenpox), a highly contagious childhood illness, and Zoster (Shingles), a neurodermic disease.
- Symptoms include fever, itching, painful vesicular eruptions, and malaise.
- The disease can be fatal in immunocompromised individuals.
- This assay tests the qualitative titer of IgG antibodies against Varicella Zoster viral antigens in patient serum.
- Transmission of this disease occurs via droplets or vertical transmission.
- The presence of IgG antibodies indicates a secondary antibody response and may persist for years.
- High VZV IgG antibodies and low VZV IgM antibodies suggest a past infection.
- False positive or negative results can be seen due to rare cross reactive Antibodies, bacterial contamination in sample, rare sample specific interferences
- This is a screening test and results should be confirmed with a confirmatory test like PCR
- The results should be interpreted in conjunction with clinical history and other findings.

Please correlate with clinical conditions.
Method:- SOLID PHASE ENZYME LINKED IMMUNOSORBENT ASSAY

Dummy Report

Tests Done : **VARICELLA ZOSTER VIRUS ANTIBODY - IGG**

Report Remarks :

Doctor 1 Sign Doctor 2 Sign

CONDITIONS OF REPORTING


- The reported results are for information and interpretation of the referring doctor only.
- It is presumed that the tests performed on the specimen belong to the patient; named or identified.
- Results of tests may vary from laboratory to laboratory and also in some parameters from time to time for the same patient.
- Should the results indicate an unexpected abnormality, the same should be reconfirmed.
- Only such medical professionals who understand reporting units, reference ranges and limitations of technologies should interpret results.
- This report is not valid for medico-legal purpose.
- Neither Thyrocare, nor its employees/representatives assume: (a) any liability, responsibility for any loss or damage that may be incurred by any person as a result of presuming the meaning or contents of the report, (b) any claims of any nature whatsoever arising from or relating to the performance of the requested tests as well as any claim for indirect, incidental or consequential damages. The total liability, in any case, of Thyrocare shall not exceed the total amount of invoice for the services provided and paid for.
- Thyrocare Discovery video link :- https://youtu.be/nbdYeRgYyQc


EXPLANATIONS

- Majority of the specimen processed in the laboratory are collected by Pathologists and Hospitals we call them as "Clients".
- **Name** - The name is as declared by the client and recored by the personnel who collected the specimen.
- **Ref.Dr** - The name of the doctor who has recommended testing as declared by the client.
- **Labcode** - This is the accession number in our laboratory and it helps us in archiving and retrieving the data.
- **Barcode** - This is the specimen identity number and it states that the results are for the specimen bearing the barcode (irrespective of the name).
- **SCP** - Specimen Collection Point - This is the location where the blood or specimen was collected as declared by the client.
- **SCT** - Specimen Collection Time - The time when specimen was collected as declared by the client.
- **SRT** - Specimen Receiving Time - This time when the specimen reached our laboratory.
- **RRT** - Report Releasing Time - The time when our pathologist has released the values for Reporting.
- **Reference Range** - Means the range of values in which 95% of the normal population would fall.

SUGGESTIONS

- Values out of reference range requires reconfirmation before starting any medical treatment.
- Retesting is needed if you suspect any quality shortcomings.
- Testing or retesting should be done in accredited laboratories.
- For suggestions, complaints, clinical support or feedback, write to us at **customersupport@thyrocare.com** or call us on **022-3090 0000**

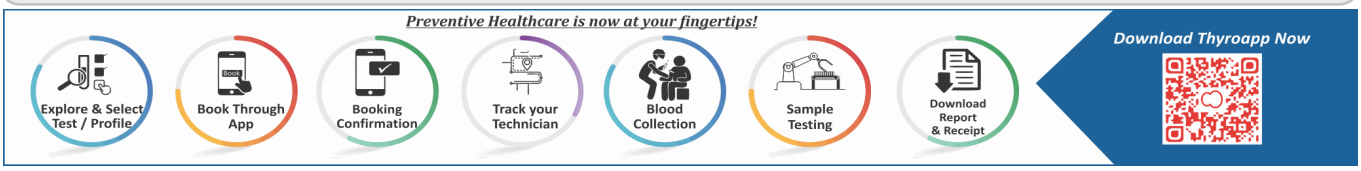

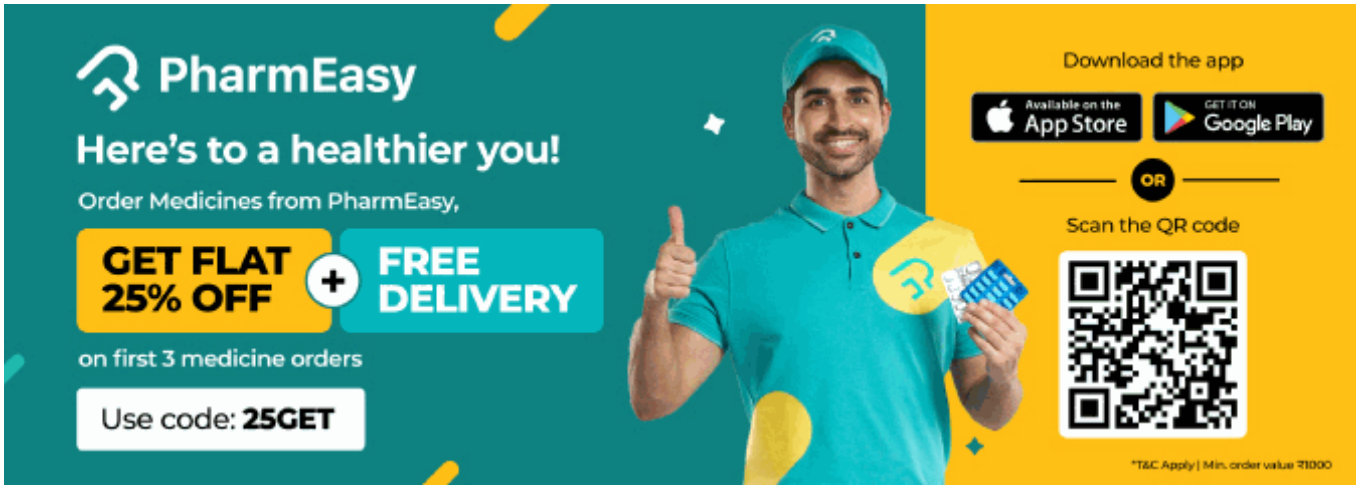

+ *T&C Apply, #As on 5th December 2024 (Applicable for all company owned labs except Bhagalpur & Vijayawada),*

⋆ *As per survey on doctors' perception of laboratory diagnostics (IJARIIT, 2023), -Mumbai Reference Lab is CAP Accredited*